


Typical Specifications - 5260 Series

Minimum NPSH Requirements &
Standard Materials of Construction - Bulletin 5260

DEMING®

www.cranepumps.com

Two Stage Split Case Centrifugal Pumps

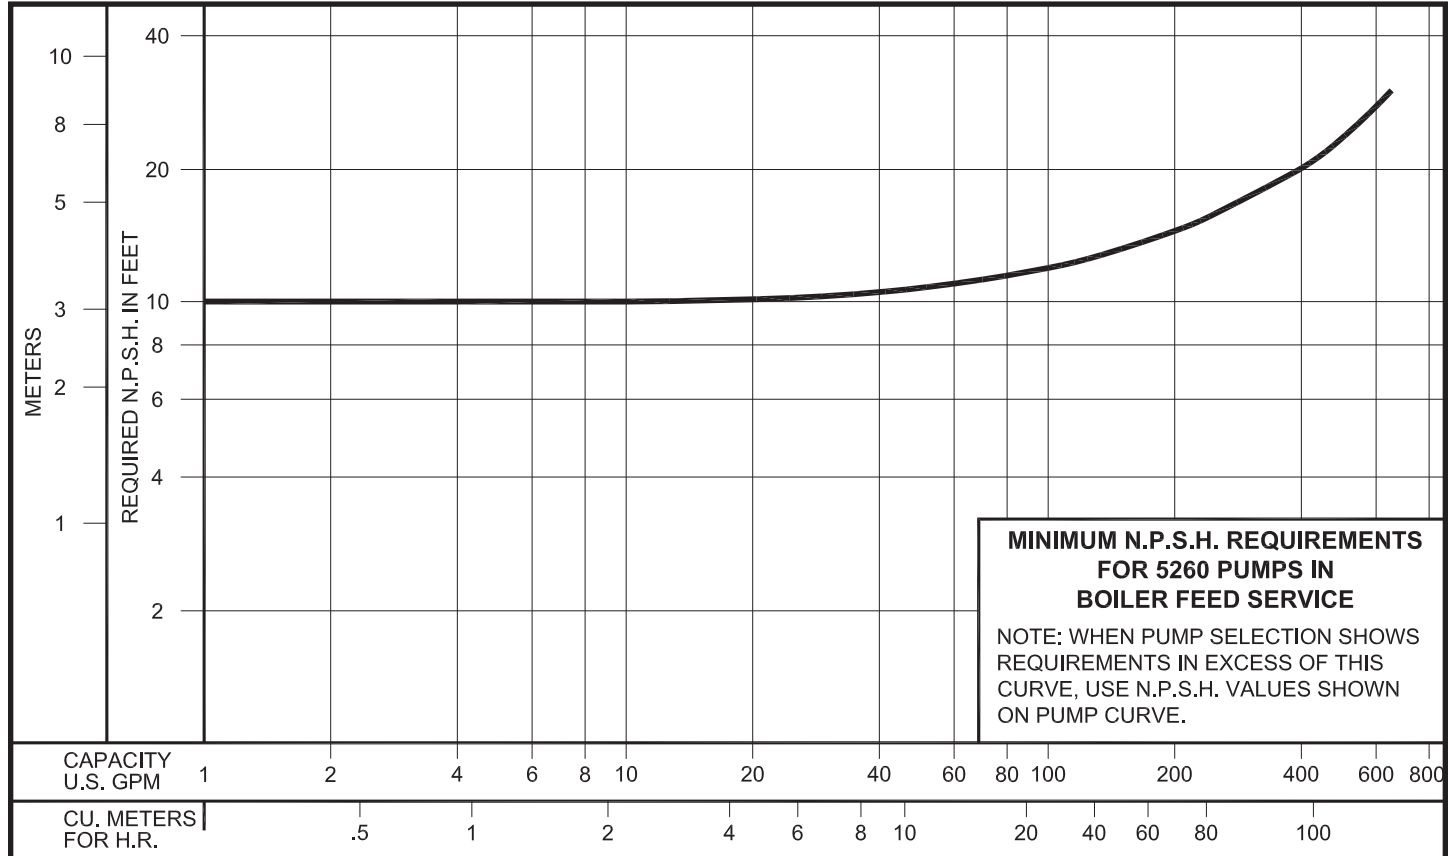

MINIMUM N.P.S.H. REQUIREMENTS FOR 5260 PUMPS IN BOILER FEED SERVICE
NOTE: WHEN PUMP SELECTION SHOWS REQUIREMENTS IN EXCESS OF THIS CURVE, USE N.P.S.H. VALUES SHOWN ON PUMP CURVE.

STANDARD MATERIALS OF CONSTRUCTION		
NAME OF PART	STANDARD FITTED	ALL IRON
Casing	Cast Iron	Cast Iron
Impellers	Bronze	Cast Iron
Case Wearing Rings	Bronze	Cast Iron
Interstage Diaphragm	Bronze	Cast Iron
Shaft	Steel	Steel
Sleeve Nut	Bronze	Steel
Shaft Sleeve	Type 416 Stainless Steel	Type 416 Stainless Steel
Gland	Bronze	Cast Iron
Throat Bushing	Bronze	Cast Iron
Seal Cage	Bronze	Cast Iron
Gland Studs and Nuts	Bronze	Steel



WARNING:
CANCER AND REPRODUCTIVE HARM -
WWW.P65WARNINGS.CA.GOV

SECTION 30
PAGE 4
DATE 10/18

CRANE
A Crane Co. Company

PUMPS & SYSTEMS

A Crane Co. Company

USA: (937) 778-8947 • Canada: (905) 457-6223 • International: (937) 615-3598