

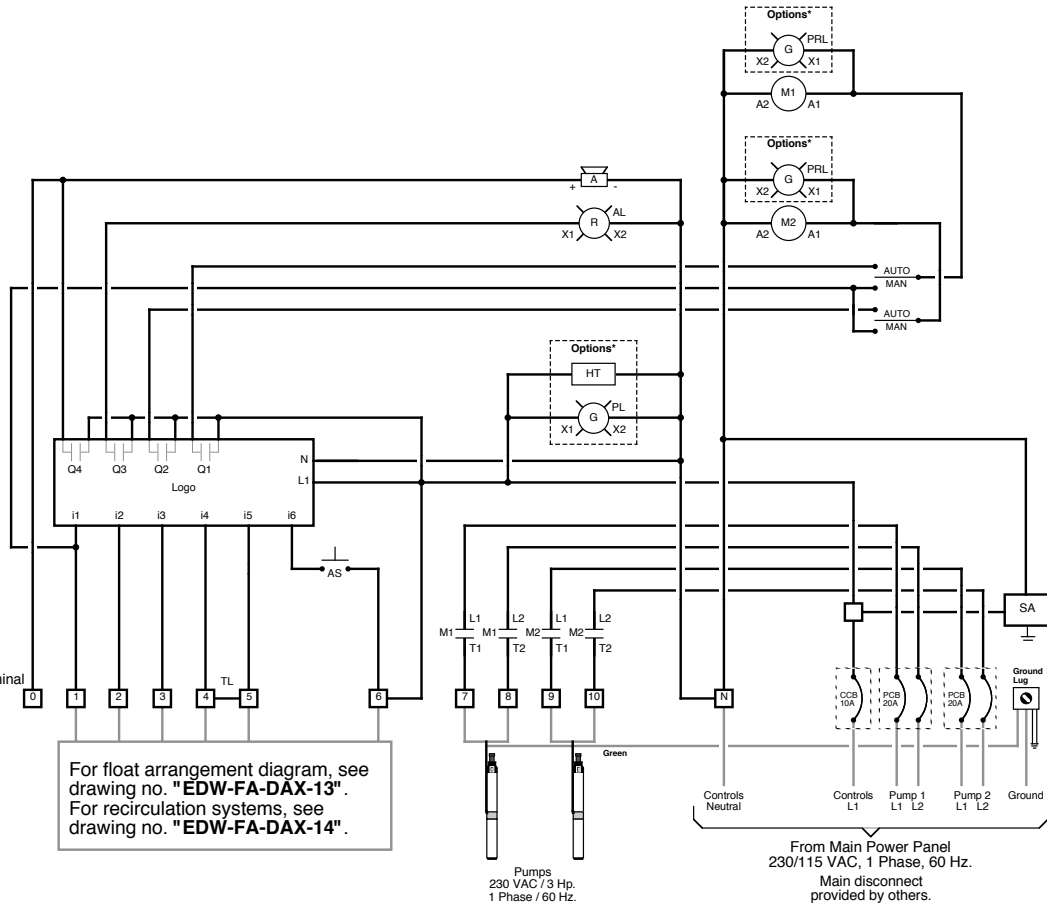


# Panel Wiring Diagram Model MVP-DAX2 PT RO SA




For float arrangement diagram, see drawing no. "EDW-FA-DAX-13".  
For recirculation systems, see drawing no. "EDW-FA-DAX-14".

NOTE: Motors must have internal overload protection

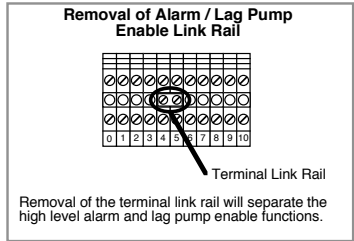

- ### Key
- = Factory Wire
  - - - = Field Wire
  - · - · - = Alternate Field Wire
  - A = Audio Alarm, 115 VAC
  - AL = Alarm Light
  - ALT = Duplex Alternator
  - AS = Audio Silence Switch
  - CCB = Controls Circuit Breaker
  - Logo = Logic Module
  - M = Motor Contactor
  - PCB = Pump Circuit Breaker
  - SA = Surge Arrester
  - SR = Silence Control Relay
  - TL = Terminal Link
- \*Options**
- HT = Heater
  - PL = Power Light
  - PRL = Pump Run Light

For MVP-DAX operation description, see drawing no. "EIN-CP-OP-4".

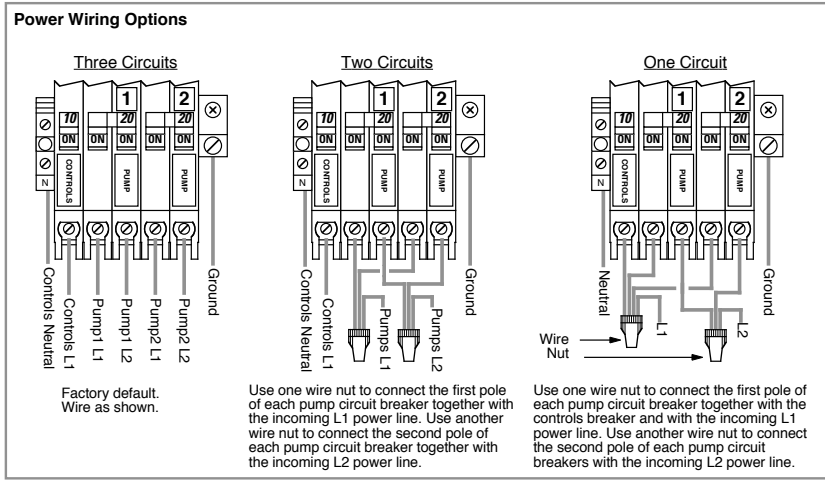

814 AIRWAY AVENUE  
SUTHERLIN, OREGON  
97479

TOLL FREE:  
(800) 348-9843

TELEPHONE:  
(541) 459-4449

FACSIMILE:  
(541) 459-2884

WEB SITE:  
www.orenco.com