

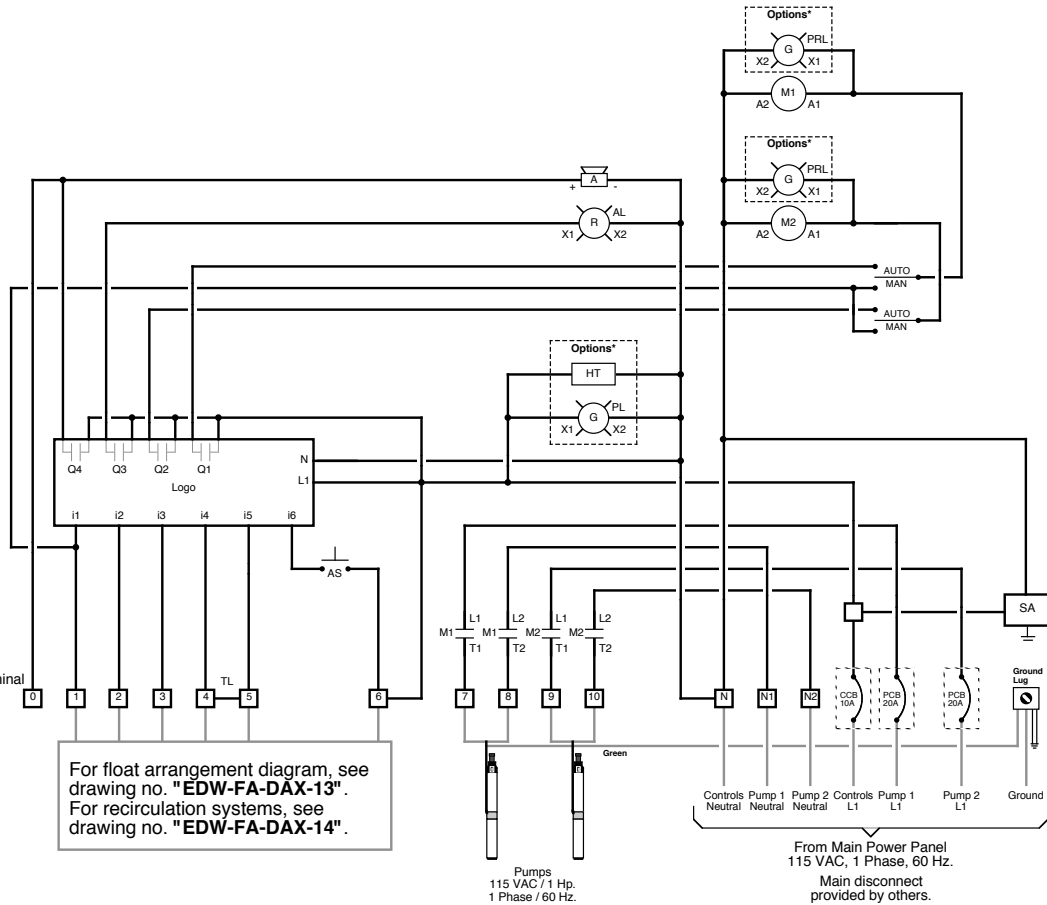


Panel Wiring Diagram Model MVP-DAX1 PT RO SA



For float arrangement diagram, see drawing no. "EDW-FA-DAX-13".
For recirculation systems, see drawing no. "EDW-FA-DAX-14".

NOTE: Motors must have internal overload protection

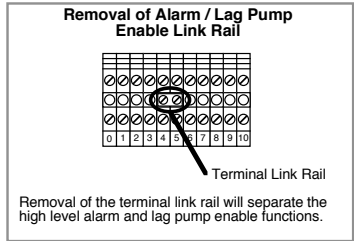

- ### Key
- = Factory Wire
 - - - = Field Wire
 - · - · - = Alternate Field Wire
 - A = Audio Alarm, 115 VAC
 - AL = Alarm Light
 - ALT = Duplex Alternator
 - AS = Audio Silence Switch
 - CCB = Controls Circuit Breaker
 - Logo = Logic Module
 - M = Motor Contactor
 - PCB = Pump Circuit Breaker
 - SA = Surge Arrester
 - SR = Silence Control Relay
 - TL = Terminal Link
- *Options**
- HT = Heater
 - PL = Power Light
 - PRL = Pump Run Light

814 AIRWAY AVENUE
SUTHERLIN, OREGON
97479

TOLL FREE:
(800) 348-9843

TELEPHONE:
(541) 459-4449

FACSIMILE:
(541) 459-2884

WEB SITE:
www.orenco.com

For MVP-DAX operation description, see drawing no. "EIN-CP-OP-4".

